

"Doon International School"

Page 1-2

OFFICE OF THE JOINT DIRECTOR FIRE & EMERGENCY SERVICES, J&K,
KASHMIR RANGE SRINAGAR

Tel. 0194-2453502
Email: jdkashmir101@gmail.com

The Principal,
Doon International School,
HMT, Srinagar.

No: JDF&ES/F-Prv/1407

Dated. 22 : 04 : 2021.

Subject: - Fire Safety Recommendations.

Sir,

Refnce:- This office letter No.JDK /F-Prv/1022 Dated 06-03-2019.

Sir,

In continuation to above referred letter, Provisional NOC valid for one year of four storeyed school building "Doon International School" situated at HMT, Srinagar is hereby issued in view:-

1. Exit. 440 Cm.
2. Corridor. 120 Cm.
3. Fire Extinguishers 02 No's in each floor.

Besides the Principal of said school has submitted an affidavit, where under he stated due to turmoil/Covid-19 in Kashmir valley during summer 2019/2020 they could not implement the fire safety requirement as laid down in previous provisional NOC. However the School Management has firmly declared in written that the below mentioned fire safety requirement will be adopted in one year from the issuance of this Fire Recommendations.

However the case for final NOC shall be considered subject to having following provisions strictly as per NBC/BIS norms & specifications;-

- a) Hose reel at each floor with overhead tank having 10,000 liters & fire pump shall be installed in the building.
 - b) Fire Retardant Paint; - Wooden components of the structures especially in attic portion shall be given fire retardant treatment of at least two hours rating.
 - c) 01 No. of 4.5 kg capacity CO2 type fire extinguisher shall be installed in each Library room & Computer Lab room, Laboratory rooms if available.
- All fire extinguishers shall be of ISI marked.

"Doon International School"

Page 1-2

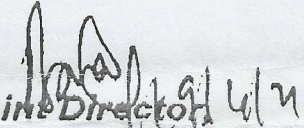
d) Precautions:-

- i. All escape routes shall be kept free from any obstructions to provide hindrance free escape in case of emergency besides all doors, gates shall be kept unlocked during the occupancy of the school building.
- ii. Class/Halls have a capacity of more than 45 students shall have two exits.
- iii. Attic portion of the building shall not be used for any kind of storage.
- iv. Grill fitted in the windows shall be removed.
- v. Fire/Evacuation drill should be conducted regularly.
- vi. Employees of the school shall be trained for maintenance & use of Fire Fighting facilities.

The final clearance shall be given subject to the fulfillment of the above fire safety recommendations & precautions strictly as per NBC/BIS norms and specifications.

These recommendations are valid for one year and shall be renewed annually.

Yours faithfully


Joint Director
Fire & Emergency Services,
Kashmir Range Sgr.
Kashmir Range, Sgr.